


Profil rurociągu tłocznego 1 : 100/1000

ODWODNIENIE RUROCIĄGU

PRZEJŚCIE POD DROGĄ NR. 225

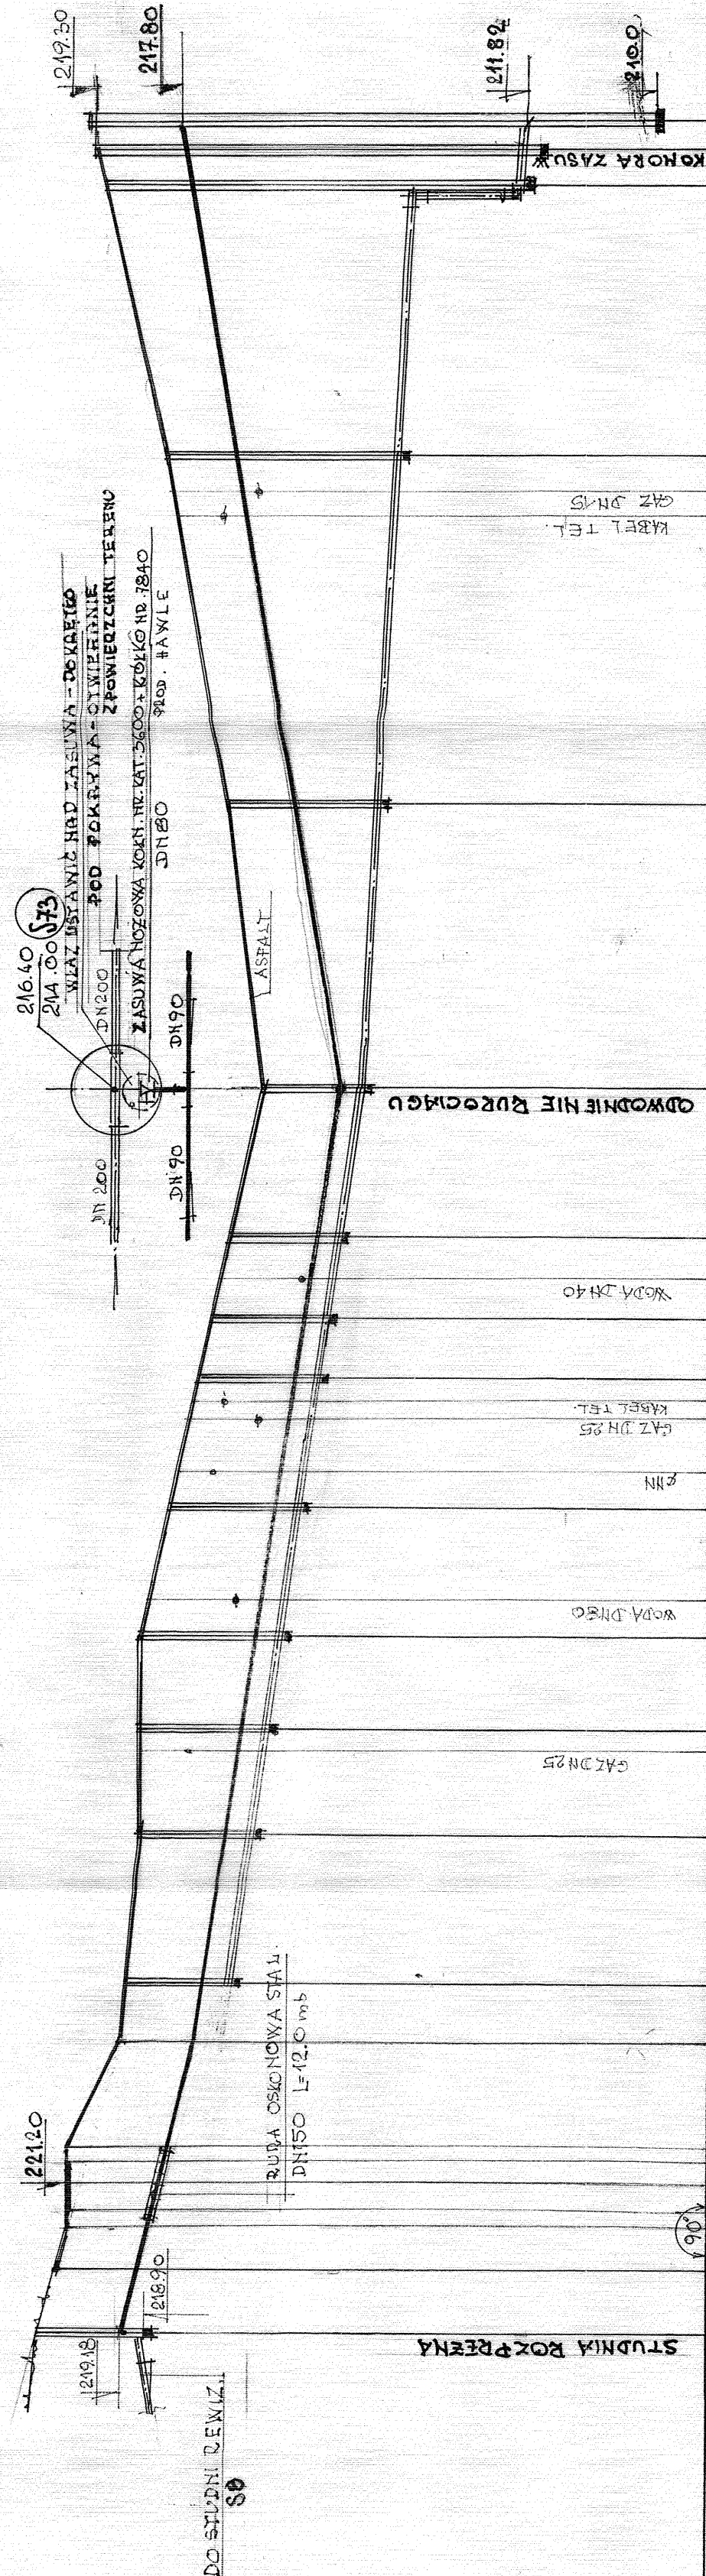

Projekt	RURCING TŁOCZNY ZRUR PE100 SDR17 PN10 dn 90x5.4 mm																			
TEMA	140	140	140	140	140	140	140	140	140	140	140	140	140	140	140	140	140	140	140	140
INWES	0.00	176.0	176.0	176.0	176.0	176.0	176.0	176.0	176.0	176.0	176.0	176.0	176.0	176.0	176.0	176.0	176.0	176.0	176.0	176.0
in	2180	2180	2180	2180	2180	2180	2180	2180	2180	2180	2180	2180	2180	2180	2180	2180	2180	2180	2180	2180
	21930	21930	21930	21930	21930	21930	21930	21930	21930	21930	21930	21930	21930	21930	21930	21930	21930	21930	21930	21930
NUMER WIZJA	573	573	573	573	573	573	573	573	573	573	573	573	573	573	573	573	573	573	573	573
RZĘDNA TERENU	220.0	218.60	217.30	216.70	216.45	216.60	216.45	216.60	216.45	216.60	216.45	216.60	216.45	216.60	216.45	216.60	216.45	216.60	216.45	216.60
RZĘDNA OSI PRZEWODU	218.60	217.30	216.70	216.45	216.60	216.45	216.60	216.45	216.60	216.45	216.60	216.45	216.60	216.45	216.60	216.45	216.60	216.45	216.60	216.45
DDŁUGOŚCI I SPADKI	390.0	218.60	217.30	216.70	216.45	216.60	216.45	216.60	216.45	216.60	216.45	216.60	216.45	216.60	216.45	216.60	216.45	216.60	216.45	216.60
ZAGŁĘBIENIE	140	140	140	140	140	140	140	140	140	140	140	140	140	140	140	140	140	140	140	140
MATERIAŁ	140	140	140	140	140	140	140	140	140	140	140	140	140	140	140	140	140	140	140	140